STORM DRAIN LINE CROSSING ABOVE EXISTING SEWER PIPE

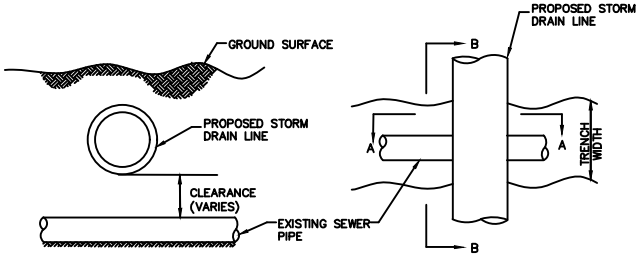

SECTION PLAN

FOR CLAY/ PVC PIPE:

1. IF THE CLEARANCE BETWEEN STORM AND SEWER PIPES IS LESS THAN 24 INCHES THE EXISTING SEWER PIPE SHALL BE PROTECTED BY CONCRETE PAD.

FOR DIP PIPE:

1. IF THE CLEARANCE BETWEEN STORM AND SEWER PIPE IS LESS THAN 18 INCHES THE EXISTING SEWER PIPE SHALL BE PROTECTED BY CONCRETE PAD.

NOTE: NOT TO SCALE

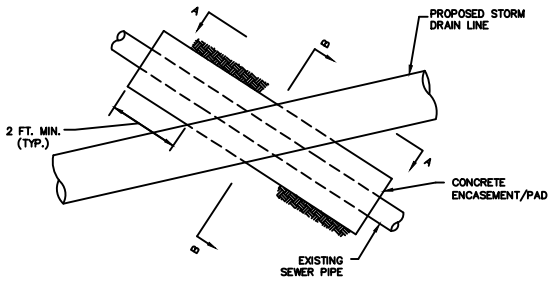

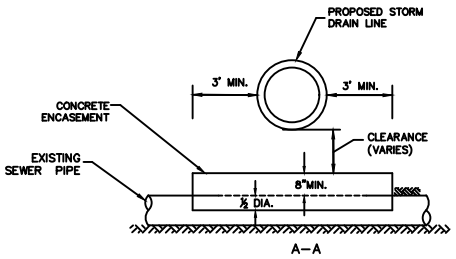

A–A

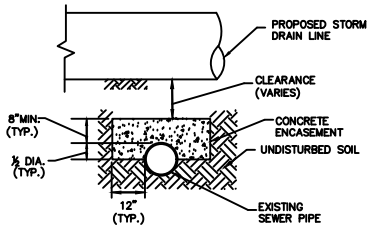

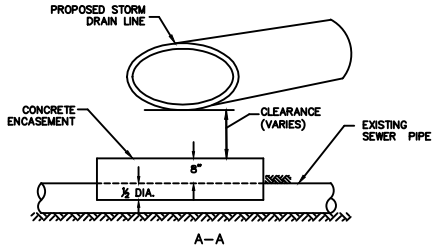

A–A

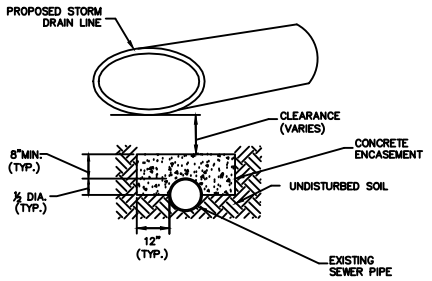

FULTON COUNTY STANDARD DETAIL 712 CROSSING ABOVE EXISTING SANITARY SEWER PIPE	DATE	REVISIONS	DATE	REVISIONS	DGS/DRN/CHKD: AD/AH APPROVED: REW DATE: 01-30-18	FULTON COUNTY	FULTON COUNTY WATER RESOURCES DEPARTMENT 141 PRYOR ST. ATLANTA, GA. 30303 404-612-7400 FAX: 404-224-0498	DRAWING NO. 712