



NOTES:

1. SERVICE LINE SHALL BE CONTINUOUS 1" TYPE "K" COPPER FROM MAIN TO METER WITHOUT ANY COUPLINGS.
2. USE ALL FLARE JOINTS.
3. INSTALLATION SHALL ALLOW ADEQUATE ROOM TO REMOVE AND/OR REPAIR METER.
4. NEW WATER MAIN SUBJECT TO 250 LB PRESSURE TEST FOR TWO HOURS.
5. EDGE OF METER BOX TO BE WITHIN 6" OF R/W OR ESMT. LINE. BOX TO BE OUTSIDE OF SIDEWALK.
6. THE BUILDER IS TO PROVIDE A SHUT-OFF VALVE IN A SEPARATE VALVE BOX FOR OWNER'S USE ON THE OWNER'S PROPERTY.
7. MODIFIED POLYETHELENE METER BOX SHALL HAVE NOMINAL DIMENSIONS OF 19-1/2" X 12-3/8" X 18" AND SHALL HAVE A 10,000 LB. LOAD RATING WITH A SINGLE MOUSE HOLE IN EACH END. COVER FOR METER BOX SHALL BE MODIFIED POLYETHELENE WITH "WATER METER" IN MINIMUM 1" HIGH LETTERS. LIDS SHALL HAVE OBLONG KNOCK OUT AND 1/2-INCH RECESS FOR METER ANTENNAE WITH A FERROUS MAGNET IN THE LID AND A PLASTIC LOCKING MECHANISM. THE COVERS SHALL HAVE A NON-SKID SURFACE. METER BOX AND LID SHALL BE DFW METER BOX MODEL 1219-18-1MKF DEEP. LID ONLY SHALL BE MODEL 1219-1-MKF DEEP.
8. LID FOR STRETCH YOKE BOX SHALL BE DFW MODEL 6514-1-MKF DEEP WITH OBLONG KNOCK OUT AND 1/2-INCH RECESS FOR METER ANTENNAE WITH A FERROUS MAGNET IN THE LID AND A PLASTIC LOCKING MECHANISM.
9. CURB STOPS ARE TO BE FORD ANGLE BALL SERVICE VALVE BA21-444W OR APPROVED EQUAL.
10. SHOULDERS ARE TO BE GRADED TO FINISHED GRADE PRIOR TO SETTING THE METER BOXES.
11. SERVICE SHALL HAVE 10" MINIMUM COVER AT METER AND 48" MINIMUM COVER BETWEEN MAIN AND METER.

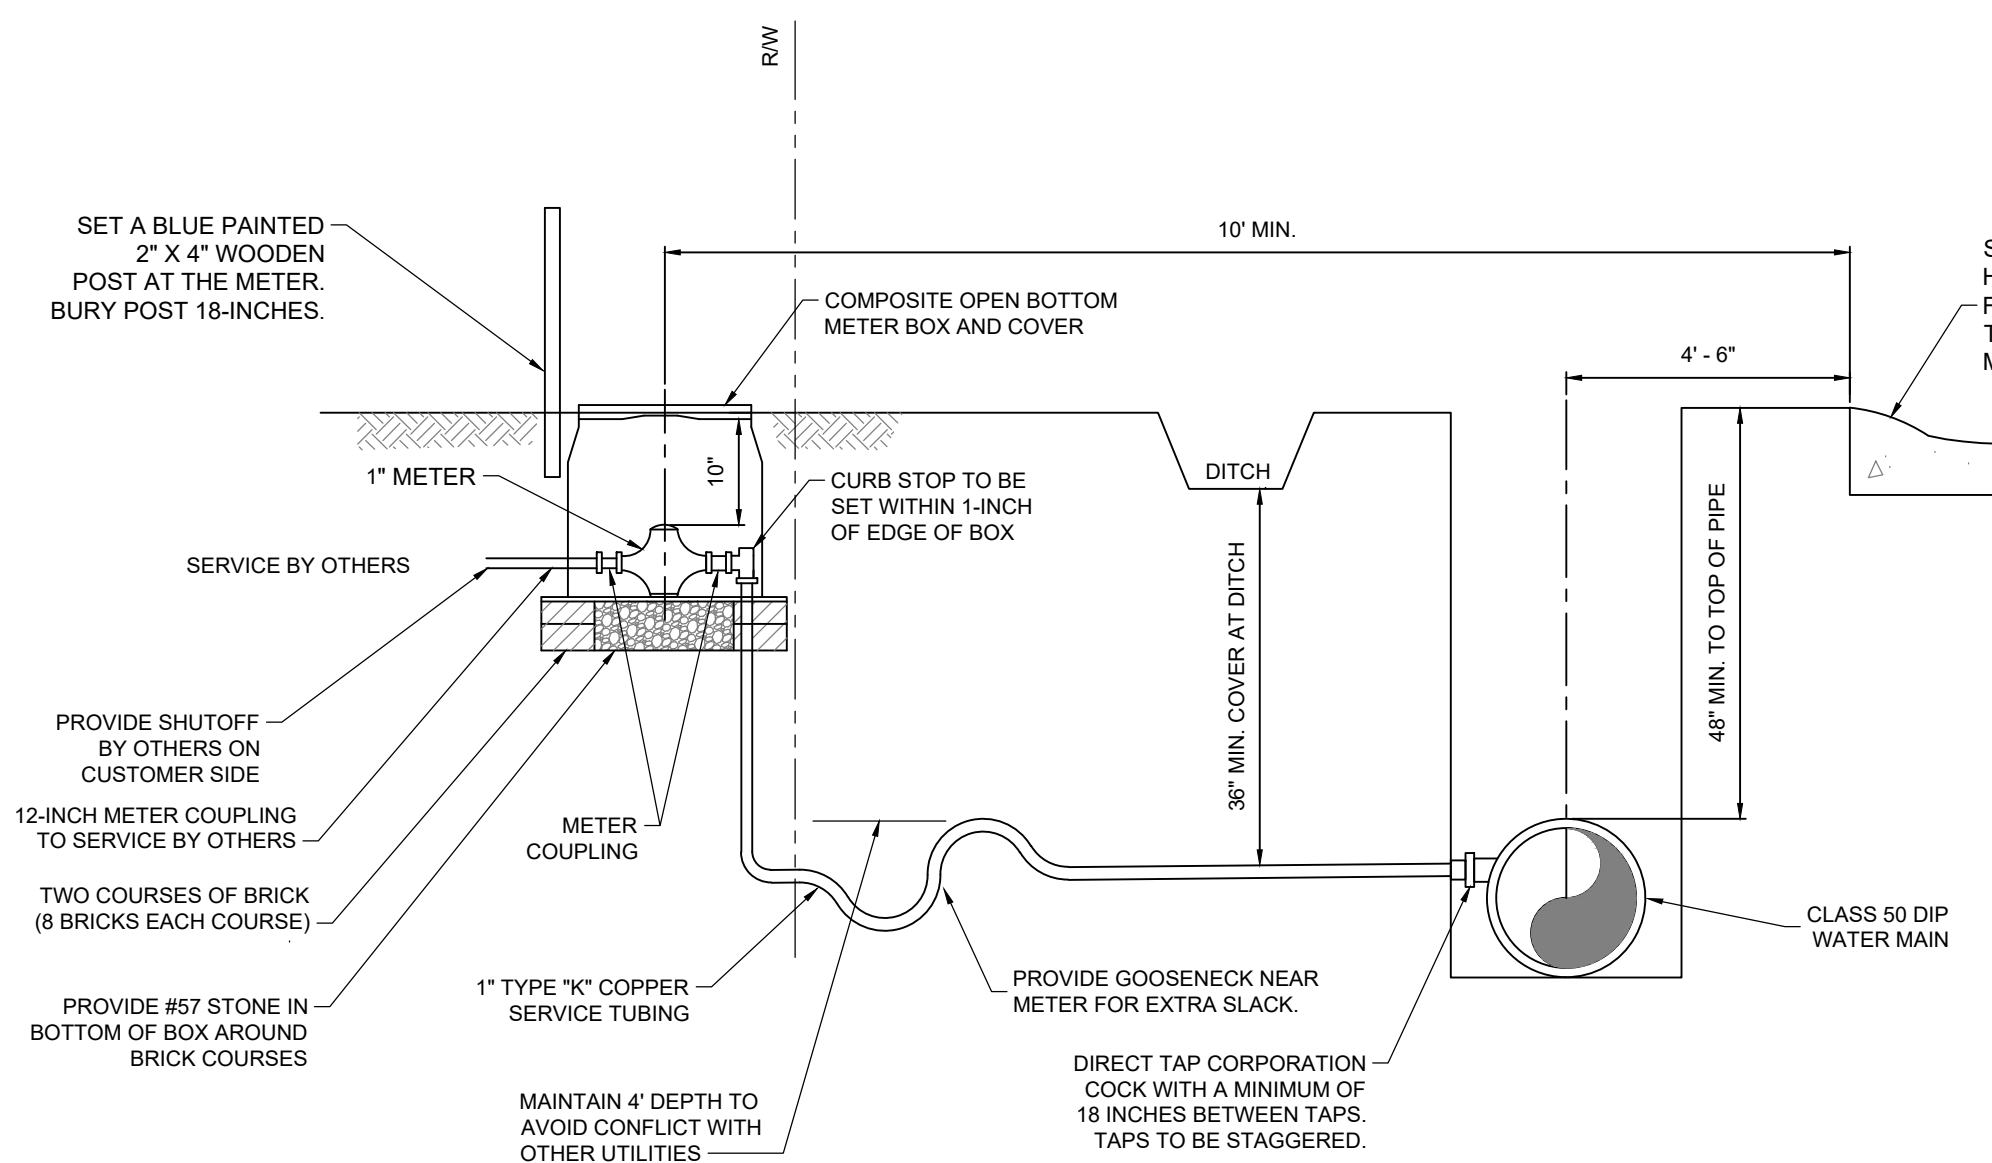

METER INSTALLATION ELEVATION DETAIL
NTS

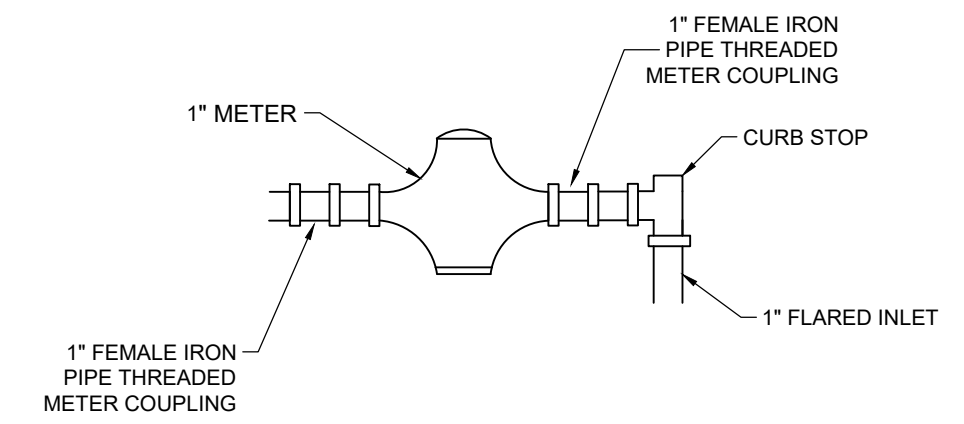

METER DETAIL
NTS

95% SUBMITTAL

FULTON COUNTY STANDARD DETAIL 802
1" METER INSTALLATION

DATE	REVISIONS	DATE	REVISIONS
M/Y	XXX	M/Y	XXX

DGS/DRN/CHKD: XXX
APPROVED: XXX
DATE: XX-X-XX



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
802