


NOTES:

1. TAP, METER, AND BACKFLOW PROTECTION DEVICE MUST MATCH MAIN SIZE IN DEVELOPMENT.

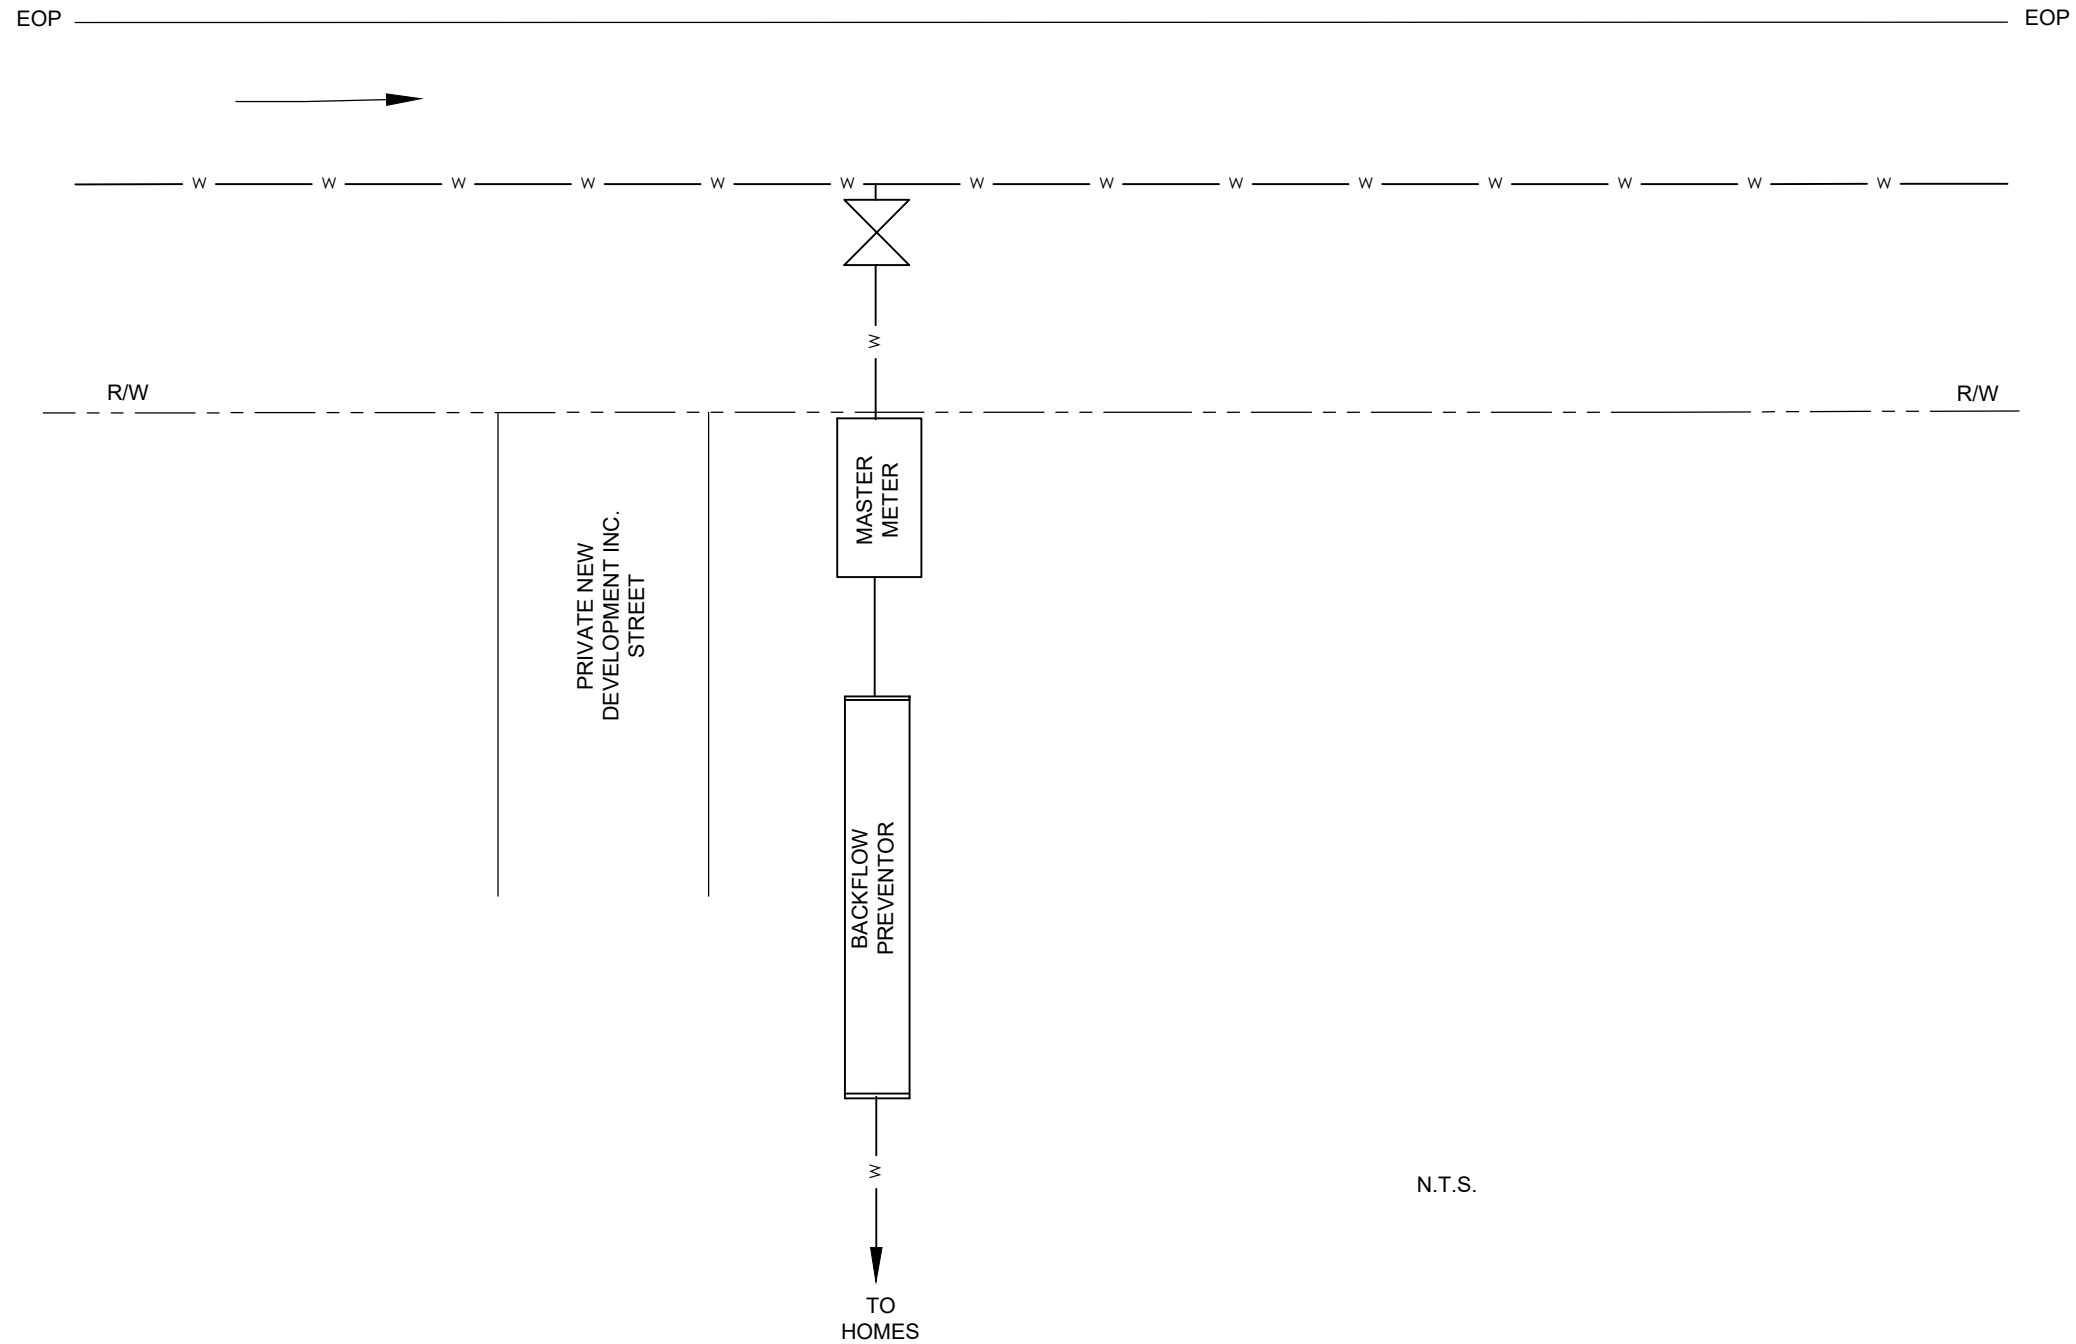

N.T.S.

95% SUBMITTAL

FULTON COUNTY STANDARD DETAIL 816
PRIVATE DEVELOPMENT WATER SERVICES
TOWNHOME/ APARTMENT/ CONDO

DATE	REVISIONS	DATE	REVISIONS
M/Y	XXX	M/Y	XXX

DGS/DRN/CHKD: XXX
APPROVED: XXX
DATE: XX-X-XX



FULTON COUNTY PUBLIC WORKS
141 PRYOR ST. ATLANTA, GA. 30303
404-612-7400 FAX: 404-224-0498

DRAWING NO.
824